



NOTE:
THIS ARRANGEMENT IS ONLY AVAILABLE WHERE
THE EASEMENT OVER PROPERTY A IS NOT ACHIEVED.

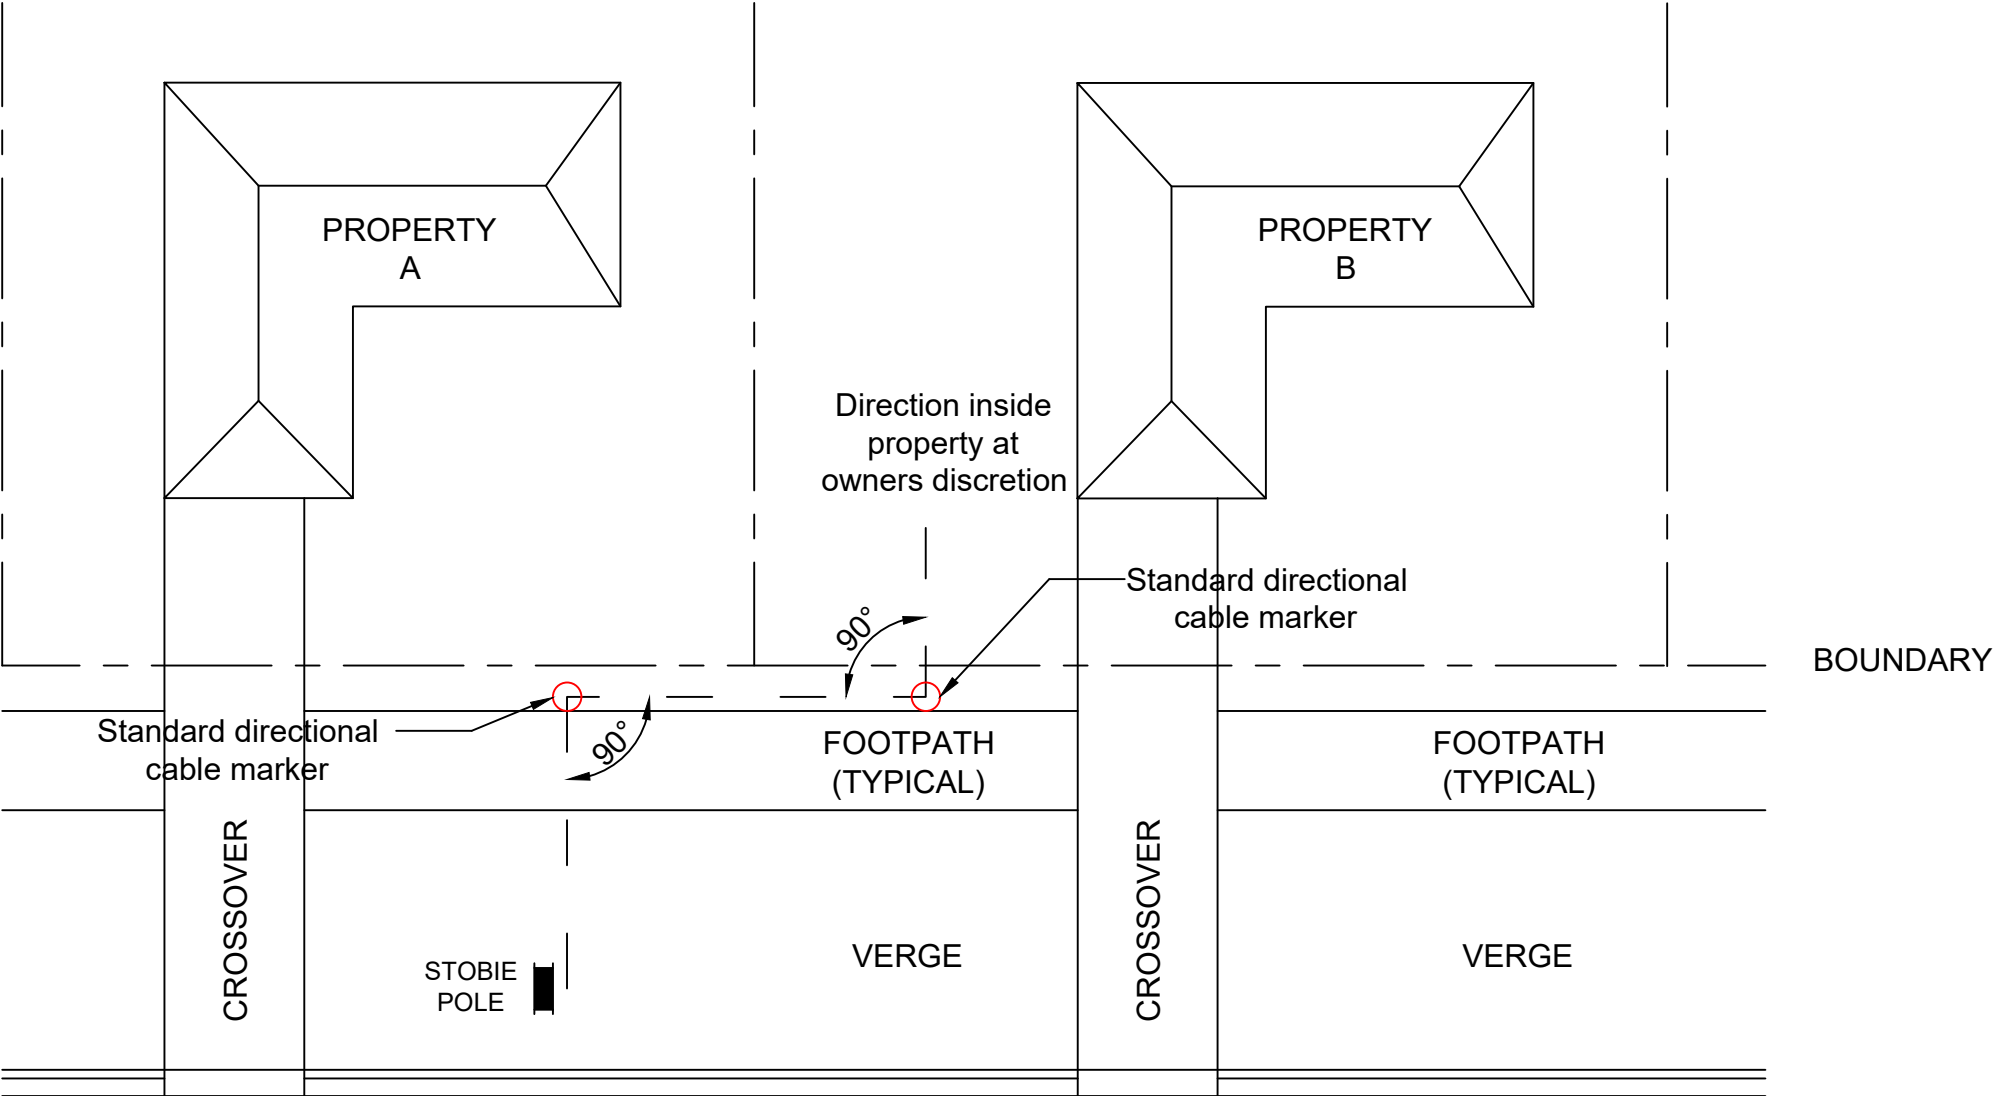

PLAN VIEW
(NTS)

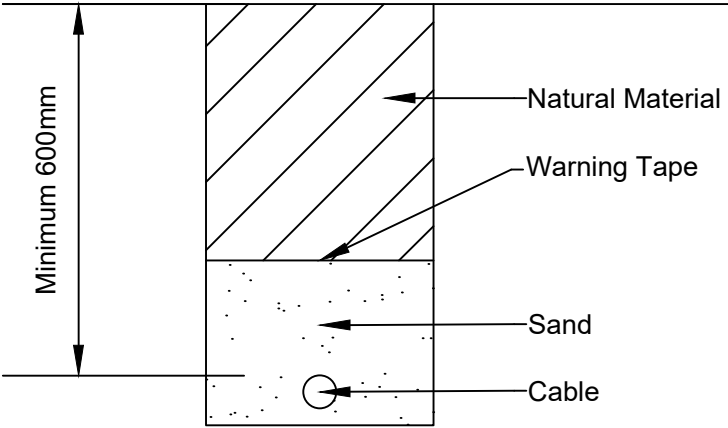

SECTION THROUGH TRENCH
(NTS)

IMPORTANT NOTES:

- All underground electrical service connections shall be laid in accordance with requirements of SA Power Networks and the Australian Standard 3000.
- The underground electrical connection to the property shall only be undertaken by a suitably licensed contractor.
- The underground cable is to be laid at 90° to street alignment from the ETSA pole to the building alignment of the property.
- Footpath shall be reinstated in accordance with City of Campbelltown Standard detail SD 5 and SD 6 and within 2 working days. Should full and satisfactory reinstatement not be completed 2 working days of backfilling of the excavation, Council will perform the necessary work and levy the full costs against the property owner.
- The cable is to be laid in open cut excavation (not bored).
- The minimum cover for the cable is to be 600mm.
- The bottom 300mm of the trench is to be backfilled with sand and warning tape placed on top.
- The cable is to be laid 400-900mm from the property boundary (subject to prior use).
- Cable markers with arrows are to be placed at all bends and spaced at not more than 10 metres along straights.
- Council will not accept liability for any damage or claims resulting from the opening or breaking up of the footpath or laying of the underground service.
- No responsibility will be accepted by the Council for any damage to the electrical services from any causes whatsoever.
- Changes to services need to be organised with the relevant utilities at owners expense.

WARNING
BEWARE OF UNDERGROUND SERVICES
The locations of underground services are approximate only and their exact position should be proven on site. No guarantee is given that all existing services are shown.



- GENERAL NOTES
- Council approval must be granted prior to any works outside of the property boundary, failure to obtain approval may incur a fine of up to \$5,000. (Local Government Act 1999 or the Planning, Development and Infrastructure Act 2016)
 - The contractor shall provide all regulatory signs and warning devices for the protection of the public in accordance with Road Traffic Act 1961, Austroads Guide to Temporary Traffic Management and Work Health Safety Act 2012.
 - Owner is responsible for contacting Dial Before You Dig on 1100 to locate any services on or under the verge prior to excavating.
 - All excavated materials shall be removed from site when excavated.
 - Council reserves the right to repair any damage to Council's assets or to replace any unsatisfactory work at owners' expense.
 - If you have any further queries, please contact Infrastructures Services on 8366 9222

E				TITLE	NAME	DATE	SIGNATURE
D				SENIOR TRANSPORT OFFICER	C. HARRINGTON	05/09/24	
C				TEAM LEADER ASSET PLANNING & DESIGN	J.PATHIRANA	05/09/24	
B	SB	05/09/24	FOR APPROVAL	MANAGER OF INFRASTRUCTURE SERVICES	W. DELLA TORRE	05/09/24	
A	SB	21/08/24	ISSUED FOR COMMENTS	SCALE : NOT TO SCALE			
ISSUE	DWG	DATE	REVISION				
CHECKED: J. LEE		DRAWN: S. BARTAULA					

CITY OF CAMPBELLTOWN

UNDERGROUND ELECTRICAL SERVICE
ALONG FOOTPATH DETAIL

UPDATED AUGUST 2024

PLAN No: SD11

SHEET No. 1 of 1

ISSUE B

