




IMPORTANT NOTES:

- Minimum volume rainwater tank requirements are as follows:
 - For sites smaller than 200m² : 1000L retention tank and 1000L detention tank.
 - For sites between 200m² and 400m² : 2000L retention tank and 1000L detention tank if site perviousness is less than 30%; otherwise, the detention tank is not required.
 - For sites larger than 401m² : 4000L retention tank and 1000L detention tank if site perviousness is less than 35%; otherwise, the detention tank is not required.
- For additional details, please refer to the current Planning and Design Code from PLANSA.

WARNING
BEWARE OF UNDERGROUND SERVICES
The locations of underground services are approximate only and their exact position should be proven on site. No guarantee is given that all existing services are shown.

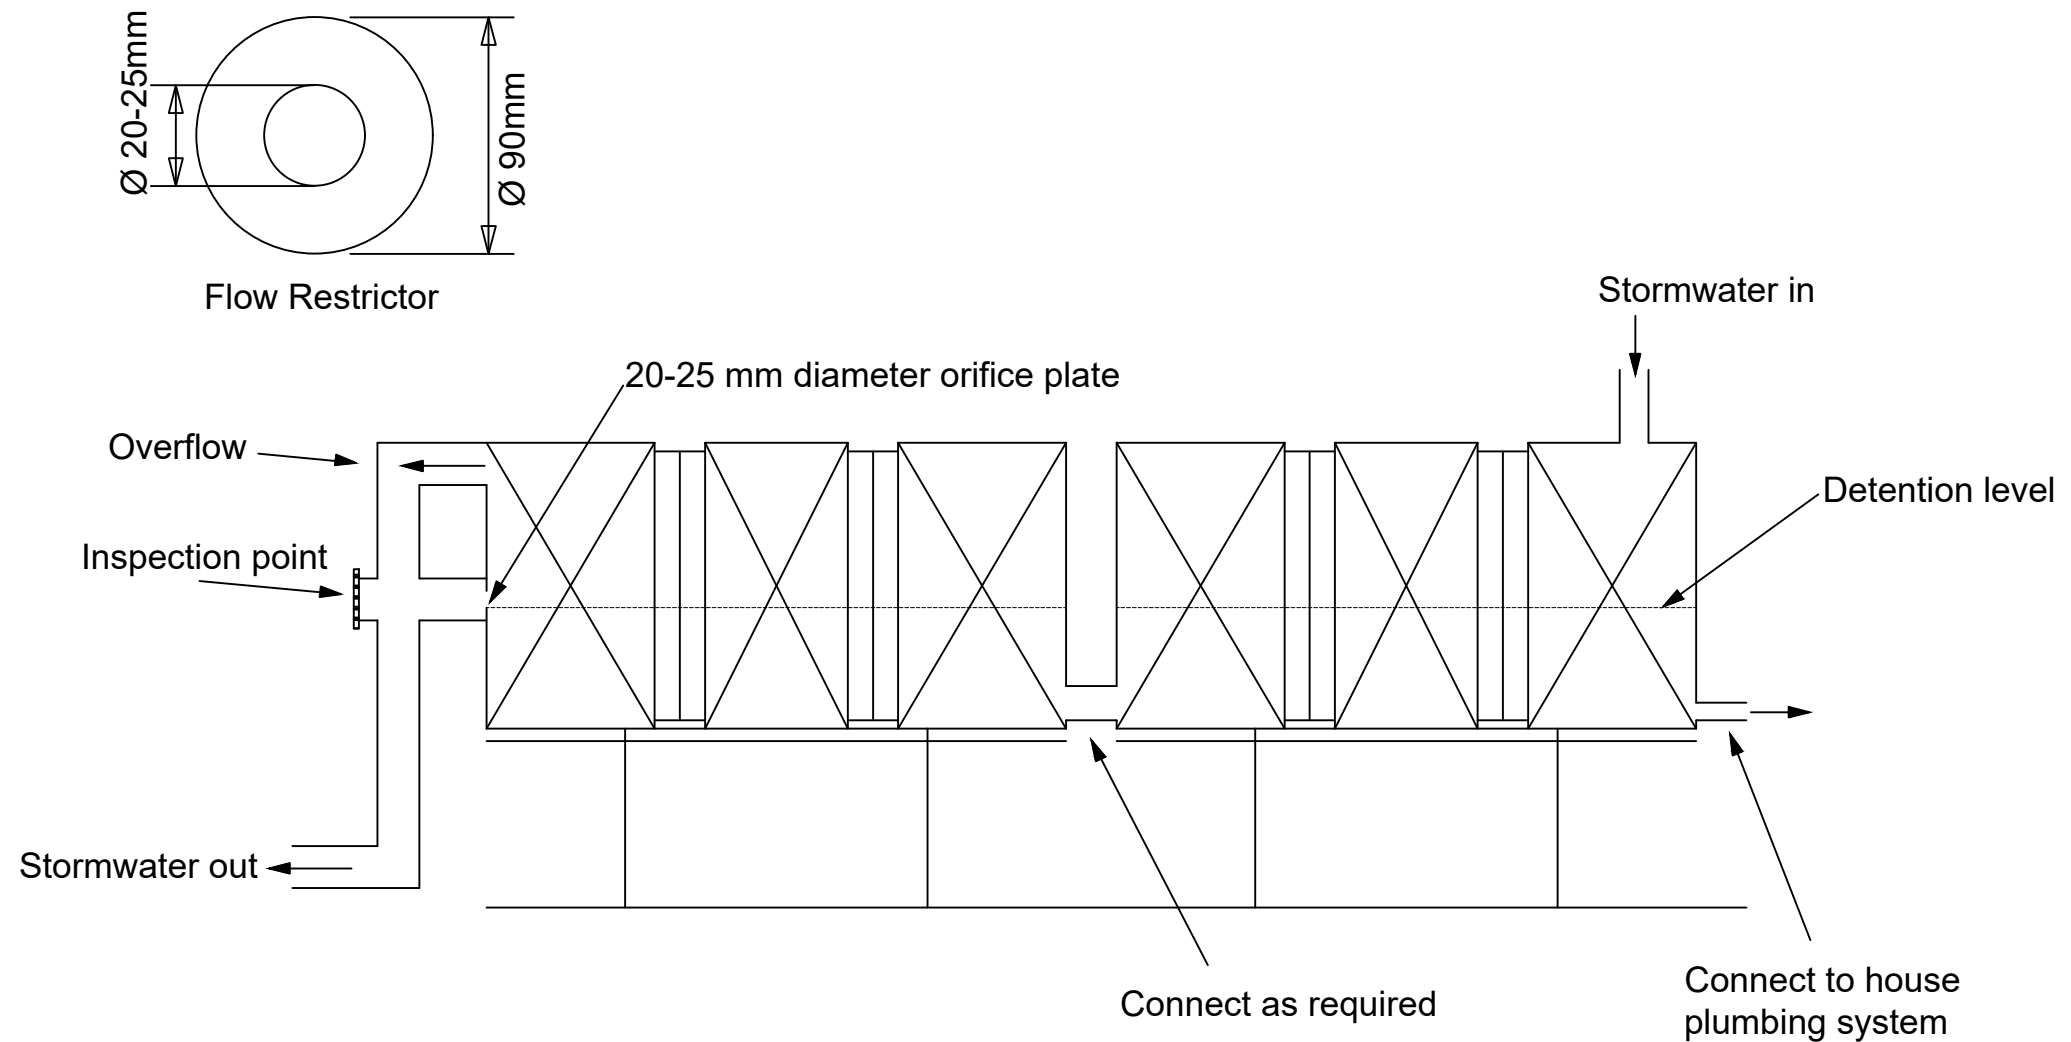

E				TITLE	NAME	DATE	SIGNATURE
D				SENIOR TRANSPORT OFFICER	C. HARRINGTON	05/09/24	
C				TEAM LEADER ASSET PLANNING & DESIGN	J.PATHIRANA	05/09/24	
B	SB	05/09/24	FOR APPROVAL	MANAGER OF INFRASTRUCTURE SERVICES	W. DELLA TORRE	05/09/24	
A	SB	21/08/24	ISSUED FOR COMMENTS	SCALE : NOT TO SCALE			
ISSUE	DWG	DATE	REVISION				
CHECKED: J. LEE							
DRAWN: S. BARTULA							

CITY OF CAMPBELLTOWN		
MINIMUM RETENTION AND DETENTION DETAIL - PRIVATE LAND		
UPDATED AUGUST 2024		
PLAN No: SD12	SHEET No. 1 of 1	ISSUE B

