



NOTE:
THIS ARRANGEMENT IS ONLY AVAILABLE WHERE THE EASEMENT OVER PROPERTY A IS NOT ACHIEVED

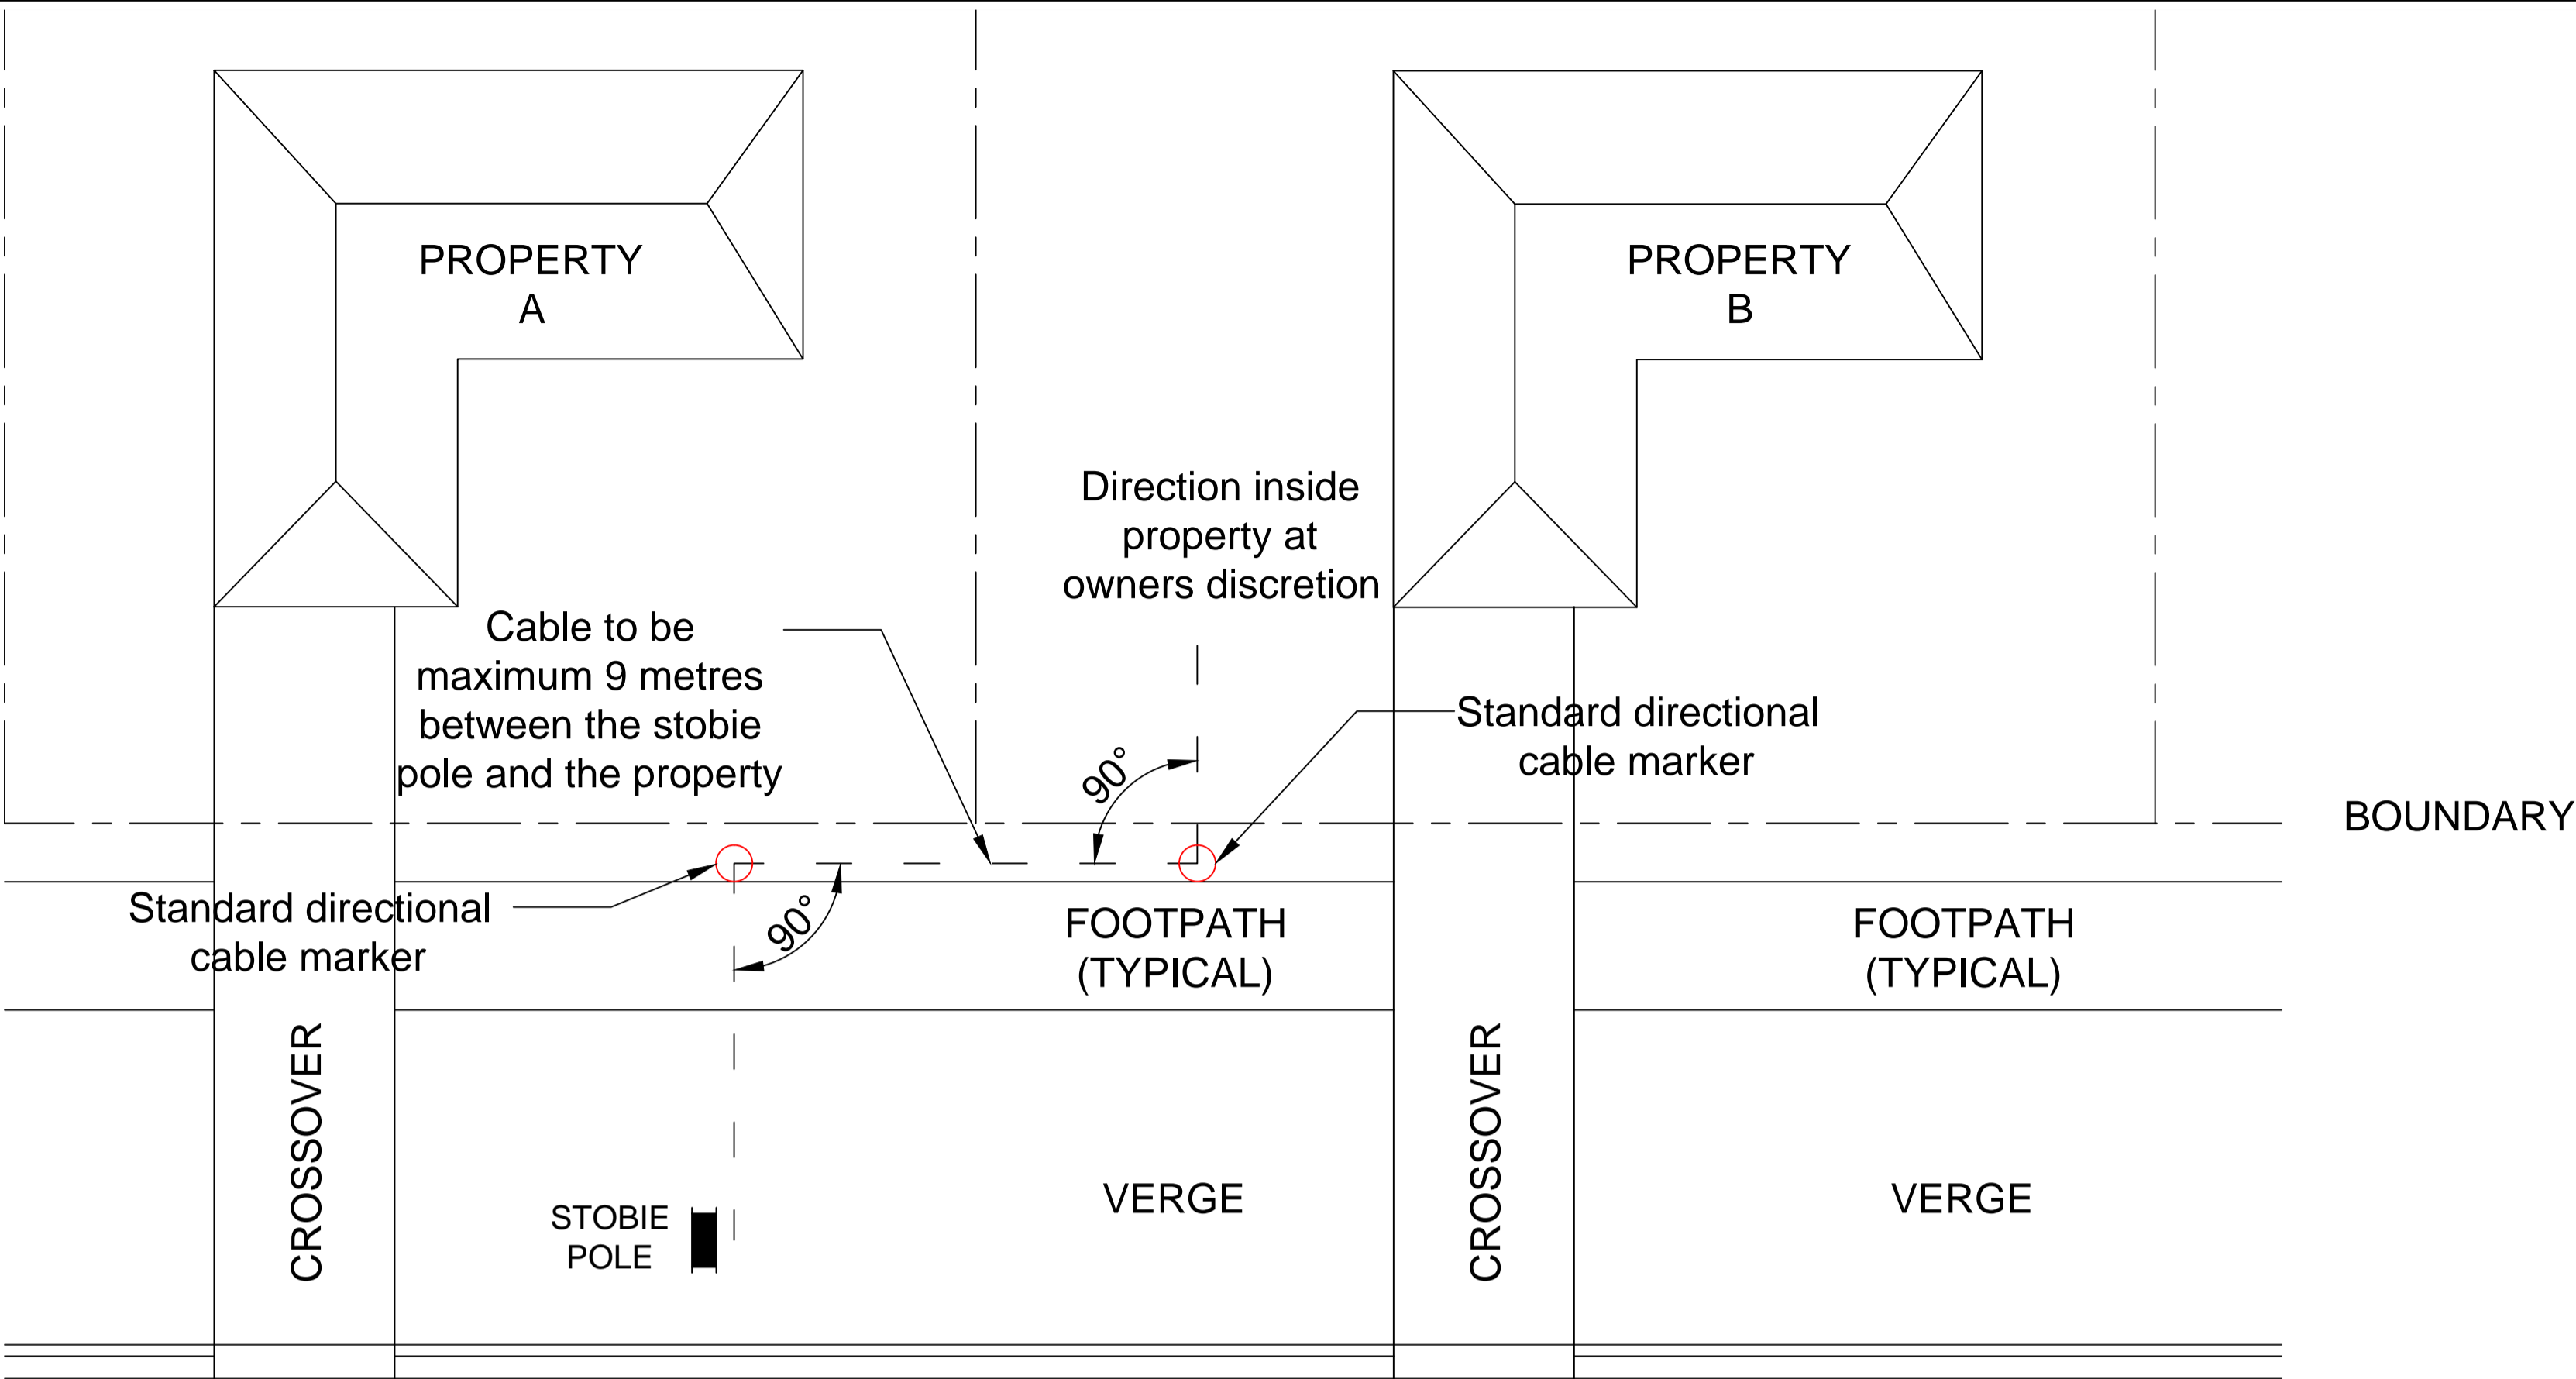

PLAN VIEW
NOT TO SCALE

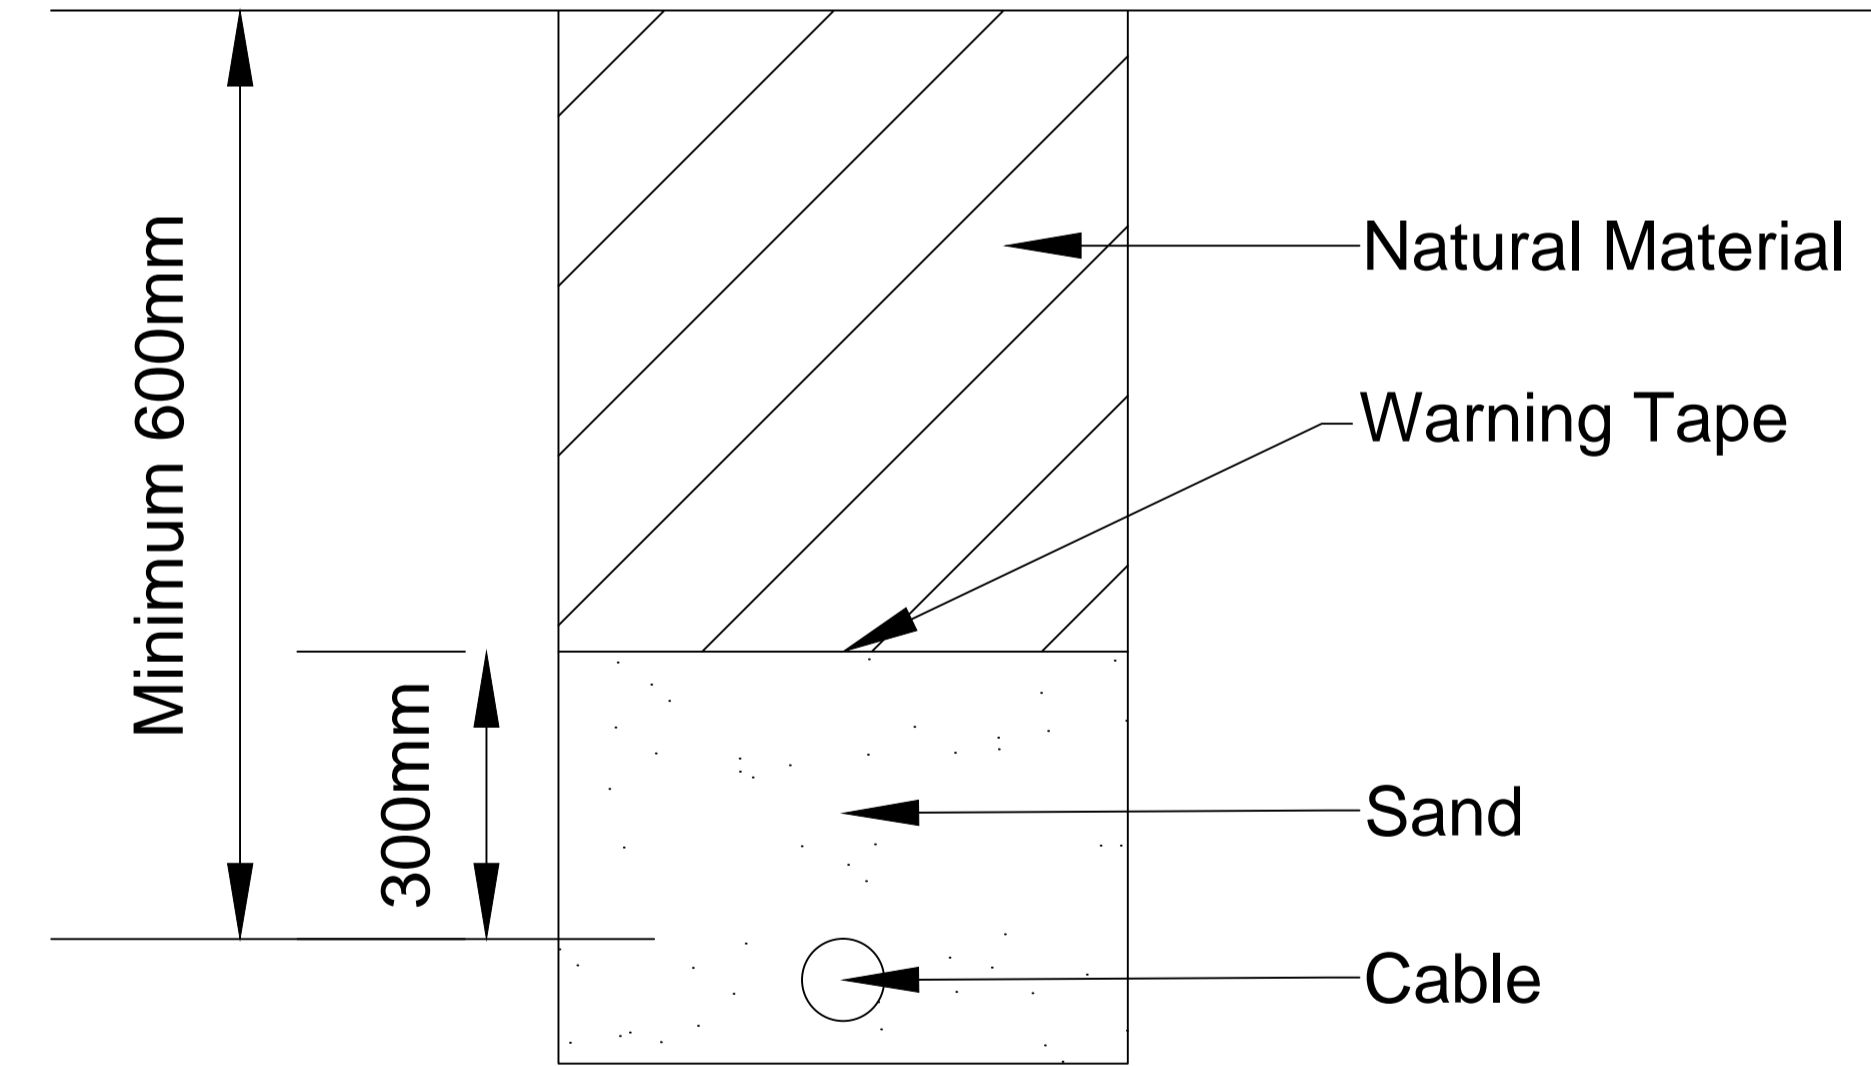

SECTION THROUGH TRENCH
NOT TO SCALE

IMPORTANT NOTES:

- All underground electrical service connections shall be laid in accordance with requirements of SA Power Networks and the Australian Standard 3000.
- The underground electrical connection to the property shall only be undertaken by a suitably licensed contractor.
- The underground cable is to be laid at 90° to street alignment from the ETSA pole to the building alignment of the property.
- Footpath shall be reinstated in accordance with City of Campbelltown Standard detail SD 5 and SD 6 and within 2 working days. Should full and satisfactory reinstatement not be completed 2 working days of backfilling of the excavation, Council will perform the necessary work and levy the full costs against the property owner.
- This standard only applies where an existing allotment cannot be served directly because there is no adjoining stobie pole. Where the indirect service is required as a result of a new land division then it is to be laid in an easement in accordance with SD 11.
- The cable is to be laid in open cut excavation (not bored).
- The minimum cover for the cable is to be 600mm.
- The bottom 300mm of the trench is to be backfilled with sand and warning tape placed on top.
- The cable is to be laid 400-900mm from the property boundary (subject to prior use).
- Cable markers with arrows are to be placed at all bends and spaced at not more than 10 metres along straights.
- An approval is required from Council to alter, erect, install or remove a structure associated with the footpath and road reserve.
- Once approved, the works are required to be carried out to Council's specification and during the course of the construction the property owner/contractors must ensure that the site is safe for pedestrian and users of the road.
- Undertake works without a permit under Section 221 of Local Government Act 1999 may result in the imposition of a fine.
- Owner is responsible for contacting Dial Before You Dig on 1100 to locate any services on or under the verge prior to excavating.
- Changes to services need to be organised with the relevant utilities at owners expense.
- Council will not accept liability for any damage or claims resulting from the opening or breaking up of the footpath or laying of the underground service.
- No responsibility will be accepted by the Council for any damage to the electrical services from any causes whatsoever.
- Council reserves the right to repair any damage to Council's assets or to replace any unsatisfactory work at owners expense.
- Please ring Council on 08 8366 9222 prior to arrange inspection.

REVISIONS AND ISSUES				DRAWING SHEET DETAILS		DESIGN VERIFICATION				City of Campbelltown UNDERGROUND ELECTRICAL SERVICE ALONG FOOTPATH	
REV	ISSUE/DESCRIPTION	DATE	APPROVED	ORIGINAL SHEET SIZE		DESIGN TITLE	NAME	SIGNATURE	DATE		
A	FOR APPROVAL	15 APRIL 2013		A1		GRADUATE ENGINEER	SS		15 APRIL 2013	PLAN No. SD 11A	
B	ADDED SURFACE MARKER	21 MAY 2013		NOT TO SCALE		MANAGER TECHNICAL SERVICES	GM				
				COORDINATE SYSTEM							
				CAD FILE NAME	STANDARDS_FINAL_RECOVER_RECOVER.DWG						
				DRAWN BY	SS						
										SHEET	
										B REV.	