



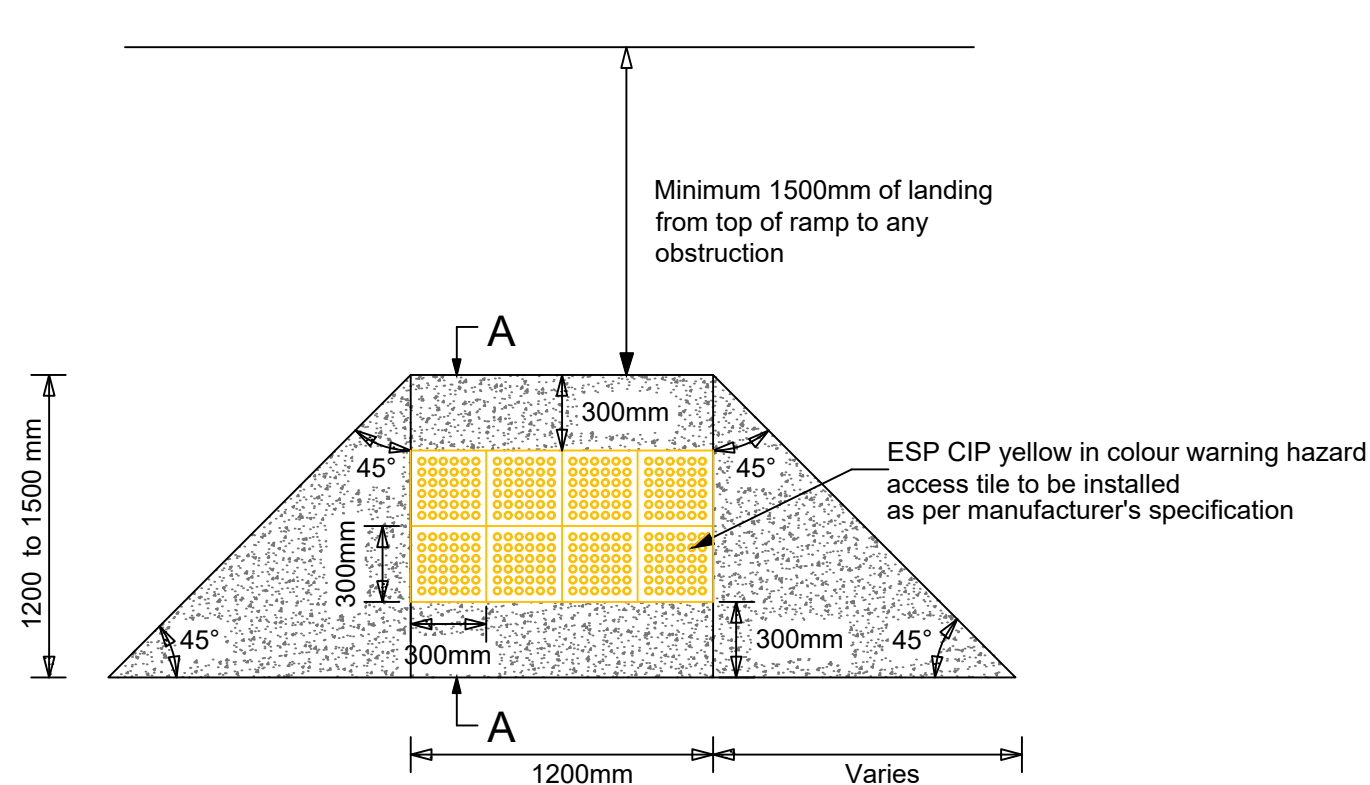


TYPICAL VIEW
(NTS)

NOTE: The diagram shown is only suitable for pram ramp with concrete tactiles. Pram ramp with stick on tactiles is to be 1250mm wide.

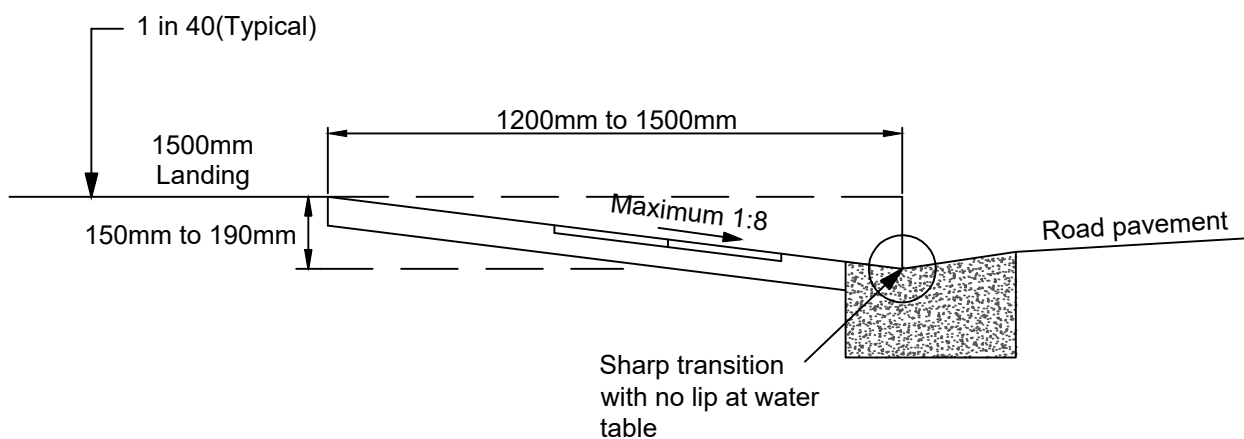

SECTION A-A VIEW
(NTS)

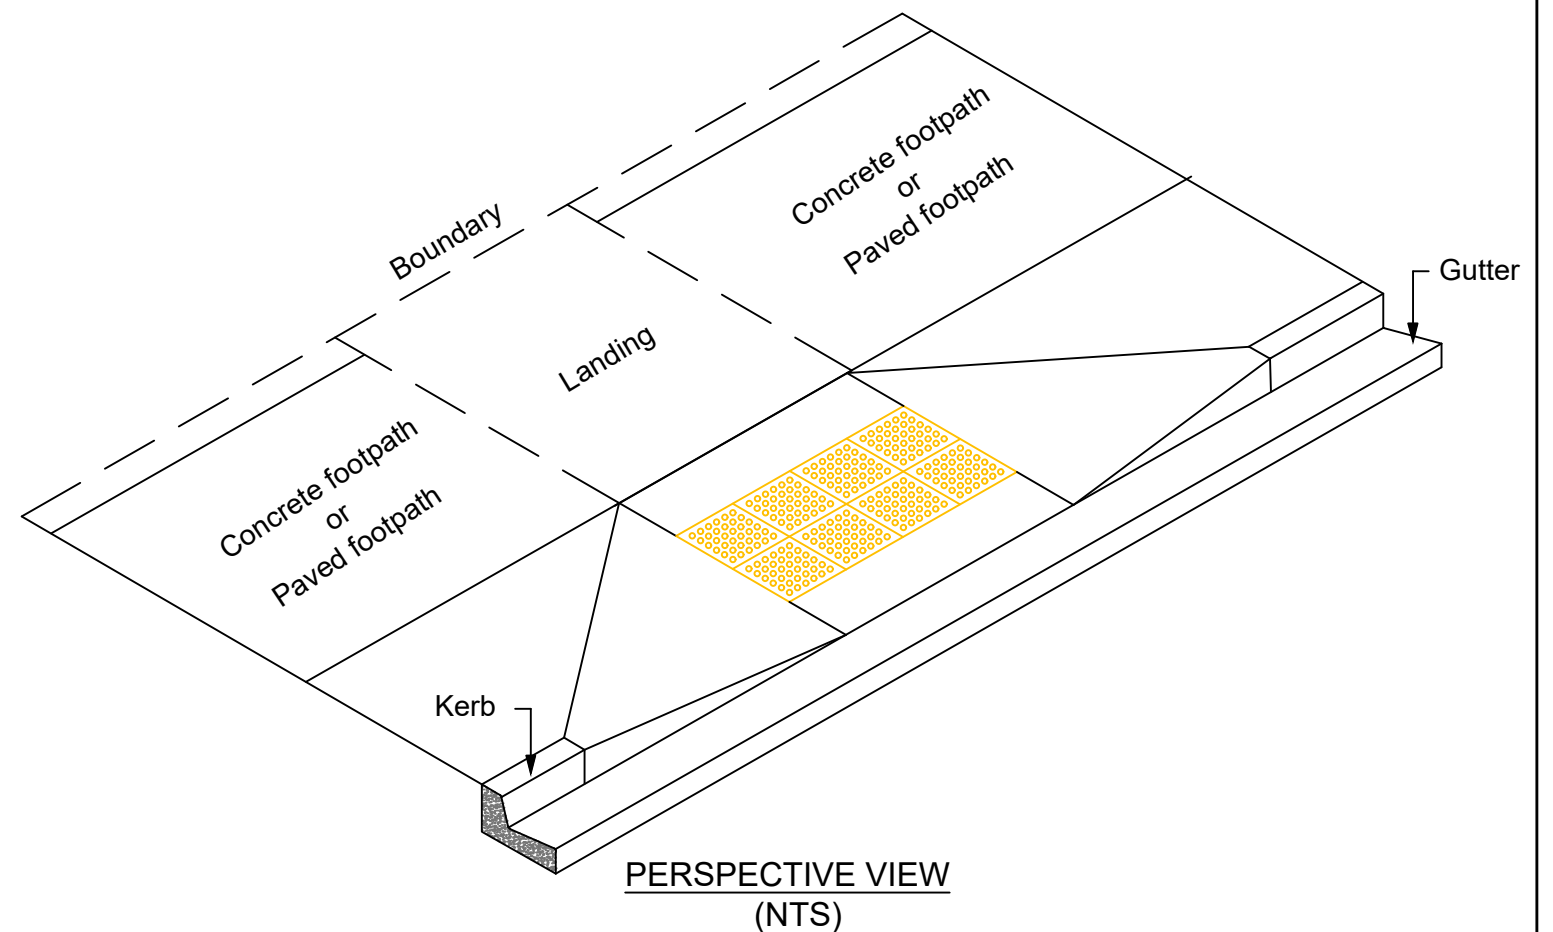

PERSPECTIVE VIEW
(NTS)

IMPORTANT NOTES:

- Maximum crossfall for the kerb ramp is to be 1:8 to comply with Australian Standard 1428.
- Minimum compressive strength of concrete shall be 25MPa at 28 days.
- All footpath adjustments shall be in accordance with Council's footpath specification SD 5 and SD6 and to Council's satisfaction.
- The ramp and the sloping sides should be slip resistant.
- Pram ramp must be aligned in the direction of travel across the road with the ramp on the far side.
- Concrete pour must take place within 2 working days of excavation.
- Should existing infrastructure including road pavement/watertable /kerbing be damaged, it must be reinstated to Council's satisfaction.
- Existing adjacent infrastructure must match the footpath.
- Changes to services need to be organised with the relevant utilities at owners expense.

GENERAL NOTES

- Council approval must be granted prior to any works outside of the property boundary, failure to obtain approval may incur a fine of up to \$5,000. (Local Government Act 1999 or the Planning, Development and Infrastructure Act 2016)
- The contractor shall provide all regulatory signs and warning devices for the protection of the public in accordance with Road Traffic Act 1961, Austroads Guide to Temporary Traffic Management and Work Health Safety Act 2012.
- Owner is responsible for contacting Dial Before You Dig on 1100 to locate any services on or under the verge prior to excavating.
- All excavated materials shall be removed from site when excavated.
- Council reserves the right to repair any damage to Council's assets or to replace any unsatisfactory work at owners' expense.
- If you have any further queries, please contact Infrastructures Services on 8366 9222

E				TITLE	NAME	DATE	SIGNATURE
D				SENIOR TRANSPORT OFFICER	C. HARRINGTON	05/09/24	
C				TEAM LEADER ASSET PLANNING & DESIGN	J.PATHIRANA	05/09/24	
B	SB	05/09/24	FOR APPROVAL	MANAGER OF INFRASTRUCTURE SERVICES	W. DELLA TORRE	05/09/24	
A	SB	21/08/24	ISSUED FOR COMMENTS				
ISSUE	DWG	DATE	REVISION	SCALE :	NOT TO SCALE		
CHECKED:	J. LEE	DRAWN:	S. BARTAULA				

WARNING
BEWARE OF UNDERGROUND SERVICES
The locations of underground services are approximate only and their exact position should be proven on site. No guarantee is given that all existing services are shown.



CITY OF CAMPBELLTOWN

PRAMP RAMP DETAIL

UPDATED AUGUST 2024

PLAN No:SD9

SHEET No. 1 of 1

ISSUE B

